


**NATIONAL KIDNEY FOUNDATION  
2010 SPRING CLINICAL MEETINGS**  
EXPO: APRIL 14-16, 2010, MEETINGS: APRIL 13-17, 2010  
WALT DISNEY WORLD DOLPHIN  
LAKE BUENA VISTA, FLORIDA

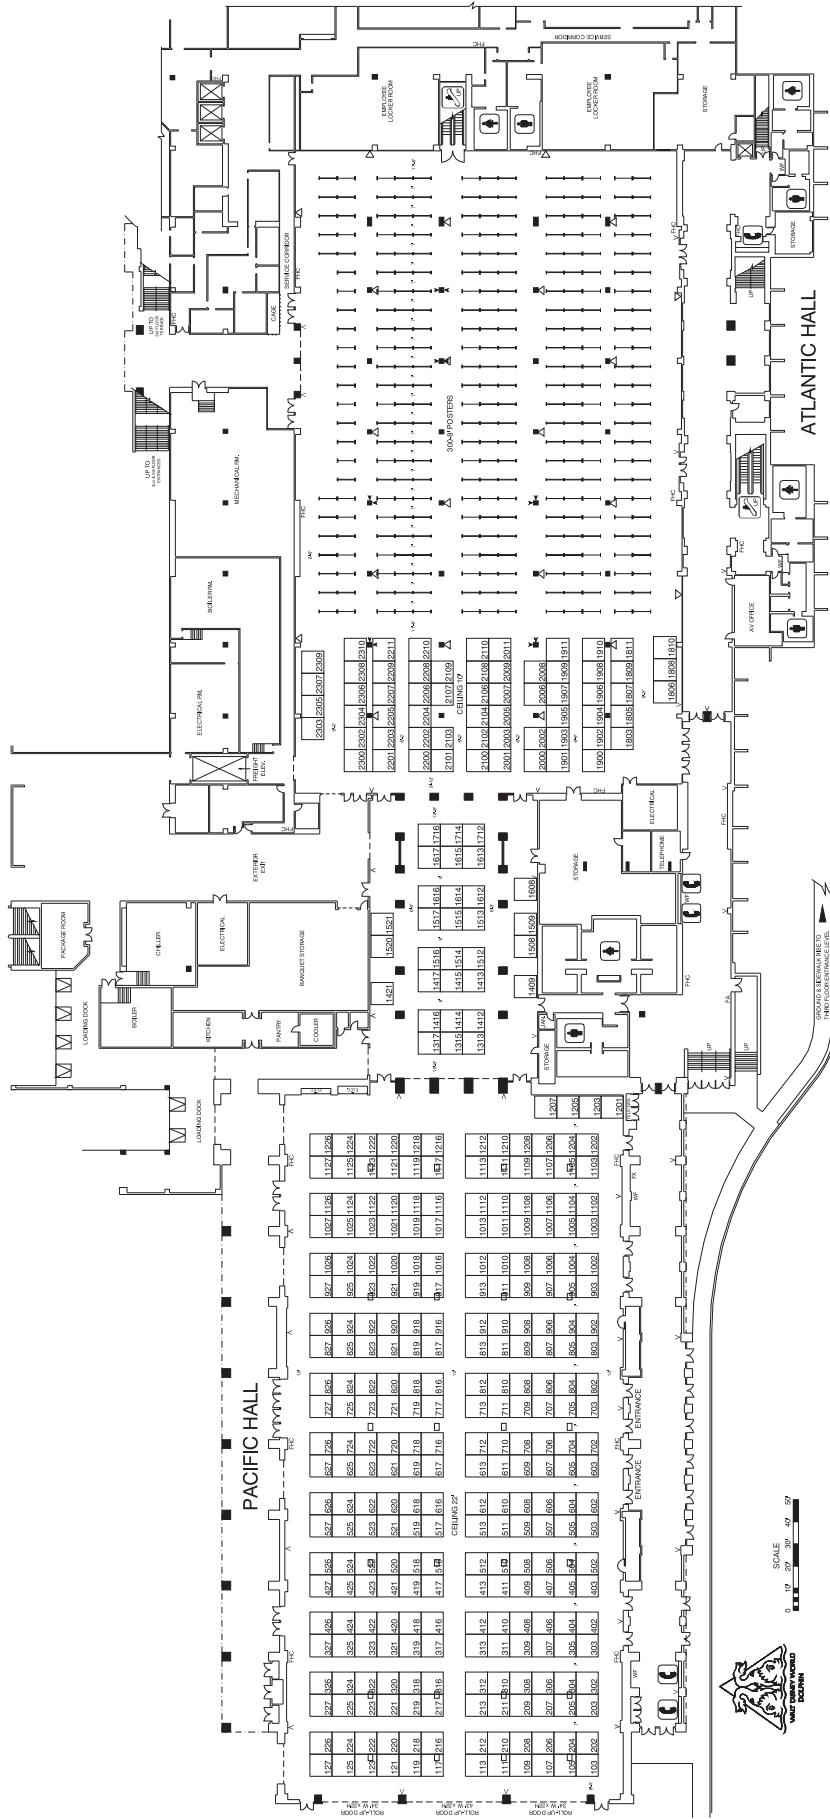

- ▽ = 60A 30 5-WIRE ELECTRICAL
  - = COLUMN
  - V = FIRE STROBE (WALL): 6'-4" H
  - ▼ = FIRE STROBE (COLUMN): 9'-10" H
  - = FLOOR PORTS
  - ▨ = FOLDED AIRWALL
- PACIFIC HALL MAX CEILING HEIGHT 22'  
ATLANTIC HALL 12' IN FRONT ONLY;  
REMAINING HALL 10' MAX

FOR FURTHER INFORMATION CONTACT:  
ROOMING@NKF.COM